



Installation Procedure

WARNING

1. Switch off before installation.
2. Switch on only after complete installation and examination of the circuit.
3. Professional electrician for installation and maintenance only.




Turn Off
Power Supply


Downlight

Cutout (refer to cutout table)

IBDL125CT115	Cutout: Φ 115mm
IBDL125CT140	Cutout: Φ 140mm
IBDL125CT170	Cutout: Φ 170mm
IBDL125CT200	Cutout: Φ 200mm
IBDL125CT220	Cutout: Φ 220mm




1 2

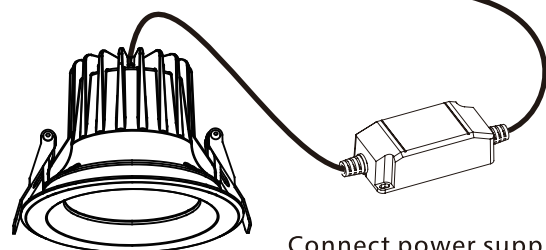


Connect power supply


If the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.

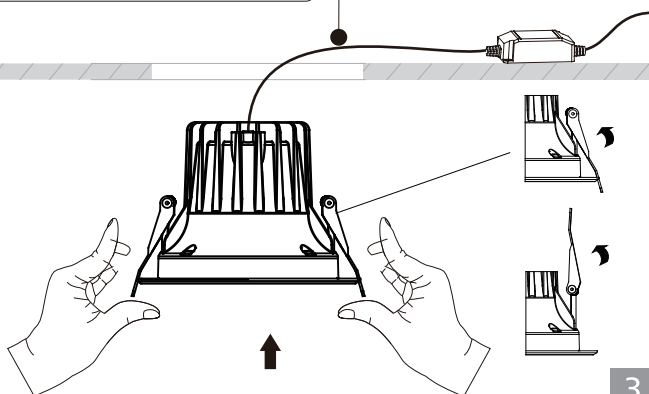

3 4

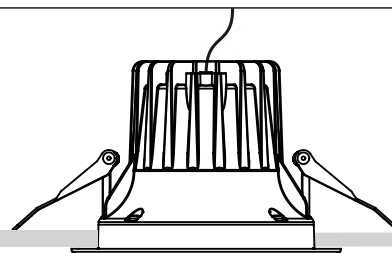

COMPLETE



The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.



Caution, risk of
Electric shock.