



Installation Procedure


WARNING

1. Switch off before installation.
2. Switch on only after complete installation and examination of the circuit.
3. Professional electrician for installation and maintenance only.




Turn Off
Power Supply

Downlight



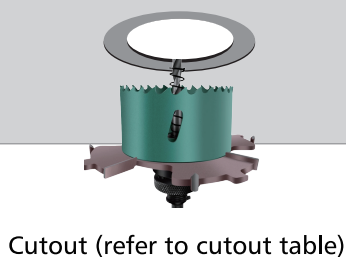


Cutout (refer to cutout table)


Cutout: $\Phi 75\text{mm}$




1 2

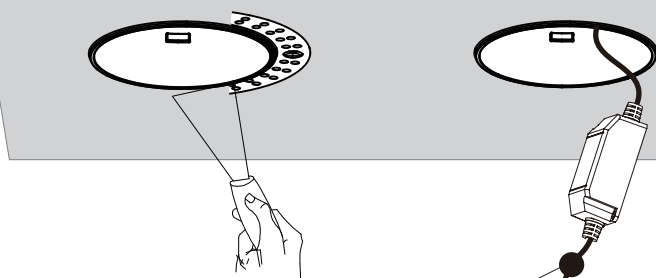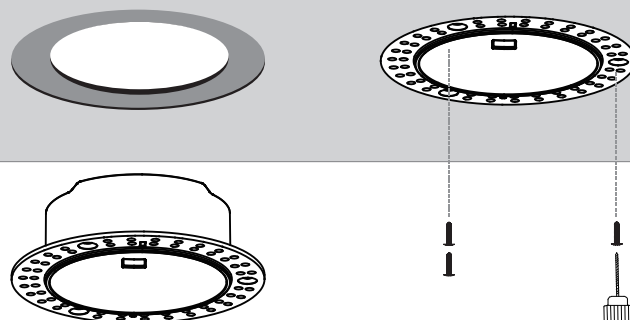


If the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.



3 4

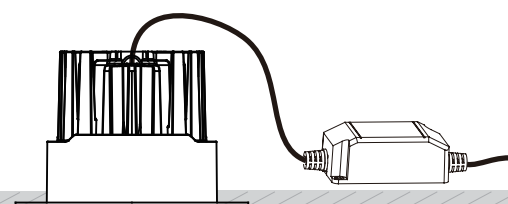

COMPLETE



The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.



Caution, risk of
Electric shock.

Model	Cutout
IBSP155CT075H95-TL	$\Phi 75\text{mm}$
IBSP155CT075H99-TL	$\Phi 75\text{mm}$
IBSP156CT075H69-TL	$\Phi 75\text{mm}$
IBSP156CT075H89-TL	$\Phi 75\text{mm}$
IBSP156CT075H116-TL	$\Phi 75\text{mm}$
IBSP158CT075H81-PIN-TL	$\Phi 75\text{mm}$
IBSP158CT075H85-PIN-TL	$\Phi 75\text{mm}$
IBSP158CT075H81-OV-TL	$\Phi 75\text{mm}$
IBSP158CT075H85-OV-TL	$\Phi 75\text{mm}$
IBSP158CT075H81-OV2-TL	$\Phi 75\text{mm}$
IBSP158CT075H85-OV2-TL	$\Phi 75\text{mm}$
IBSP156CT050	$\Phi 50\text{mm}$