


Installation Procedure


WARNING

1. Switch off before installation.
2. Switch on only after complete installation and examination of the circuit.
3. Professional electrician for installation and maintenance only.




Turn Off
Power Supply

Downlight

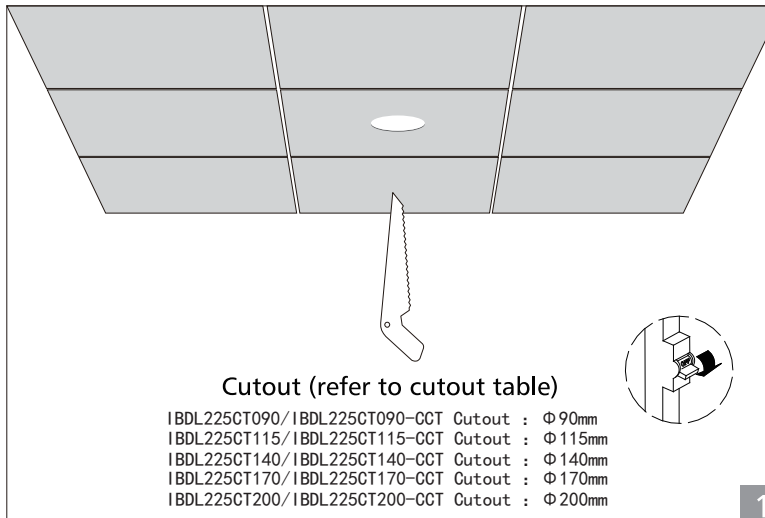


Cutout (refer to cutout table)


IBDL225CT090/IBDL225CT090-CCT	Cutout : $\Phi 90\text{mm}$
IBDL225CT115/IBDL225CT115-CCT	Cutout : $\Phi 115\text{mm}$
IBDL225CT140/IBDL225CT140-CCT	Cutout : $\Phi 140\text{mm}$
IBDL225CT170/IBDL225CT170-CCT	Cutout : $\Phi 170\text{mm}$
IBDL225CT200/IBDL225CT200-CCT	Cutout : $\Phi 200\text{mm}$

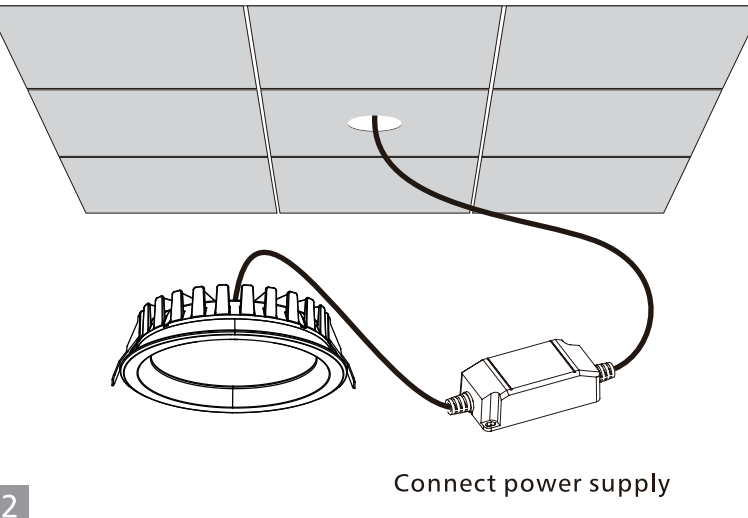

Connect power supply

If the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.

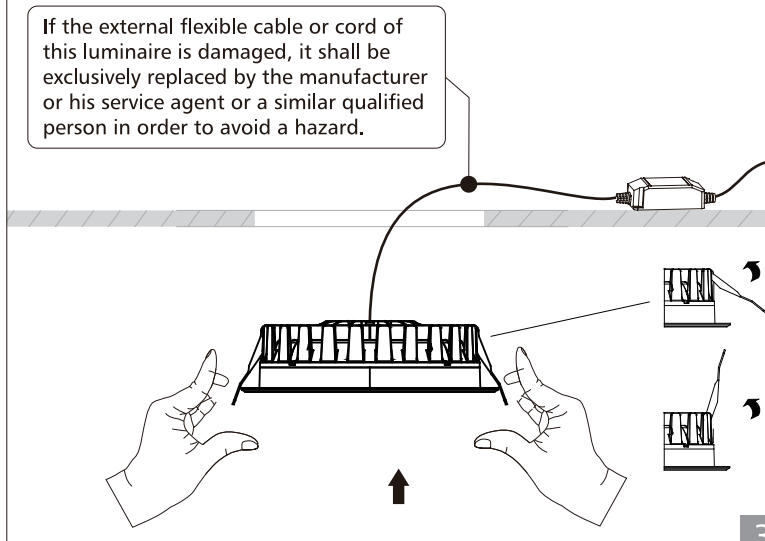

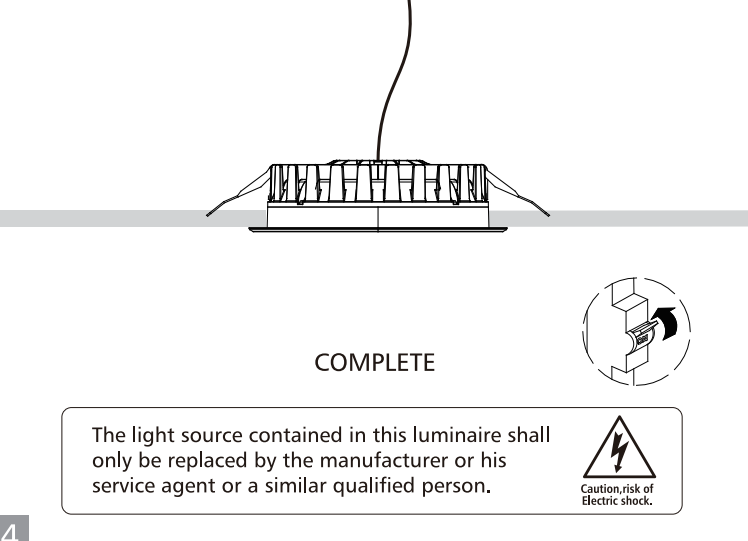


COMPLETE

The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.

1 2

3 4



Caution, risk of
Electric shock.